

SMART METER INTEGRATION

CONTORIZAREA INTELIGENTĂ ÎN ZONELE DE DISTRIBUȚIE DIN ROMÂNIA

Dragoș Florin PALADE¹

Abstract: *The dimension of energy transition is global, the technology revolution is European and worldwide. With the application of digital technologies, a new ecosystem of services develops, including decentralized generation, electric vehicles, grid flexibility and energy efficiency, contributing to a modern, low-carbon and cost effective energy market. For customers, this brings a golden age of empowered consumers, enabled by smart grids. Smart meters are the cornerstone of a smart grid, bringing added value to customers, energy distributors, suppliers, regulators and the economy. This paper draws upon the experience of Enel Group in terms of digitalisation, in Europe and world-wide.*

Keywords: smart meters, smart grids, digitalisation, consumer empowerment

Rezumat: *Dimensiunea tranziției energetice este globală, întrucât revoluția tehnologică este nu doar Europeană ci mondială. Utilizarea tehnologiilor digitale duce la dezvoltarea unui nou ecosistem de servicii, inclusiv producție la nivel descentralizat, vehicule electrice, flexibilitatea rețelelor, eficiență energetică, contribuind la o piață a energiei modernă, cu emisii reduse și costuri eficiente. Pentru clienți, aceasta înseamnă o eră de aur în care consumatorul este la putere, cu ajutorul rețelelor inteligente. Contoarele inteligente sunt baza rețelelor inteligente, aducând valoare adăugată clienților, distribuitorilor, furnizorilor, autorităților de reglementare și economiei în general. Lucrarea se bazează pe experiența Europeană și internațională a Grupului Enel în domeniul digitalizării.*

Cuvinte cheie: contorizare inteligenta, digitalizare, rețele inteligente, puterea consumatorilor

¹ Head of Smart Meter Romania, E-distribuție, e-mail: dragosflorin.palade@e-distributie.com

1. Introduction

The article aims to deal with the topic of smart metering in the electricity distribution networks in Romania, from the perspective of customers, distribution operators, electricity suppliers, the regulator, also addressing the general impact on the economy. The information is taken from the experience of the Enel Group, a pioneer in the field of smart metering worldwide, with over 50 million meters installed in the countries where it carries out electricity distribution operations. In a time when the world is undergoing an energy transition process driven by digitalization and new technologies, smart metering systems are the foundation of the future smart grids, which will enable both the delivery of advanced customer services and the efficient and low-cost operation of distribution networks, to a higher quality of service offered.

2. Smart Metering worldwide

Smart Metering is a bi-directional measurement and communication system between the meters and the DSO (Distribution System Operator) systems, which with the maximum warranties of security, allows remote access to the meters, giving the opportunity to collect readings, to manage energy, to control available power and to manage the connection / disconnection of service and while employing advanced anti-fraud mechanisms.

The Enel Group is a leader in the field of smart metering worldwide, as it is one of the first utility companies in the world to apply the concept on a large scale. Enel smart metering is found in several countries worldwide, and currently more than 50 million customers worldwide benefit from Enel Smart Meter technology, most of them in European countries, Italy and Spain, the 8th and 14th economies of the world respectively, according to the level of Gross Domestic Product (World Bank, 2018¹).

In the distribution areas of Latin America, Enel companies have installed over 415,000 smart meters in countries such as Brazil, Colombia, Peru, Chile and Argentina and their number is expected to grow significantly in the next period.

As mentioned, in Europe, where the mechanisms of the European Union support the installation of smart meters, we find a much larger number of such installed equipment, over 50 million. The number of meters in Italy amounts to about 35 million, in Spain 12 million, in Malta and Montenegro more than 300 thousand each, and in Cyprus a pilot project has

¹ <https://databank.worldbank.org/data/download/GDP.pdf>

been started, and the number of meters will increase immediately after analyzing the data of this project.

In Romania, the installation of smart meters started in 2015, until now being installed over 650,000 meters in the distribution networks managed by the companies in the Enel Group. During this year, the National Energy Regulatory Authority approved a plan for the implementation of smart meters, according to which, by the end of 2028, the Romanian distribution companies of the Enel Group will have installed over 1.6 million smart meters.

3. Overview

The main feature that differentiates intelligent metering systems from conventional meters, even electronic ones, is the connection with the E-Distribution dispatcher in order to be able to remotely automate a two-way communication flow at any time. Thus, the smart meter becomes a sensor in low voltage electrical networks, allowing the energy distributor to have much more accurate data on energy flows, consumption profiles and operating needs of the networks.

The way data is transferred from the meter to their management system is a very important one when talking about a smart metering solution. In the case of the Enel solution, the data collected from the locations where the smart meters were installed is transmitted by the PLC (Power Line Communication) technology to the secondary stations, where a data hub is installed that takes all the information from the meters installed from the respective station. Further, this information reaches the control room and, implicitly, in the application that manages them, through the public data transfer networks.

The smart metering solution uses an open communication protocol (Meters & More) and is efficient due to the fact that it uses the existing infrastructure of the electricity distribution network. The long service life of the meters (over 15 years) allows future evolutions, being a durable and reliable measurement solution, due to the low failure rate.

4. Benefits for the Ecosystem

Smart metering brings significant improvements to all stakeholders in the community. Thus, consumers benefit from:

- Invoices on real consumption;
- Remote contracts management;
- Enhanced awareness on energy use;
- Active energy management;

- More tariffs/options to choose;
- Tailored tariffs.

Thanks to smart metering, energy suppliers can benefit from the possibility of easily introducing tariffs tailored to customer needs, enriching customers experience and even introducing service differentiation.

The intelligent metering system brings benefits to the energy regulatory authority, helping to develop the energy sector, to increase the quality and reliability of electricity supply, thus enabling free-market development and management.

Last but not least, the economy also has great benefits from the smart metering, helping to develop the Smart industry, stimulate innovation, energy efficiency and lower CO₂ emissions, a great benefit for the environment.

As the Enel smart meter has the ability to measure bi-directional energy flows, it encourages the emergence of prosumers, a new category of customers, who can produce electricity in small capacity plants (most commonly photovoltaic panels), thus helping to reduce emissions in energy production.

Experience from Italy, the country that adopted a policy of massively installing smart meters in the early 2000s, shows benefits for the entire economy by reducing unplanned downtime, all these improving the quality of supply for both domestic and industrial consumers. Thus, in the distribution areas of Enel in Italy, the SAIDI (System Average Interruption Duration Index) indicator decreased from 2001, the year of the beginning of the massive digitization of the networks, to 44 minutes in 2015².

5. Benefits for the customers

Smart metering is a powerful tool to improve customer awareness, fostering energy efficiency, which brings to the customer:

- Bi-directional energy flows
- Faster reconnection
- Greater protection against overvoltage in the network or other possible incidents
- Faster contract changes
- Higher security, thanks to encrypted information
- Information for an efficient consumption

² [https://www.enel.com/content/dam/enel-com/investors/presentations/2016_10/Enel%20Group_2016%20Capital%20Markets%20Day%20\(22Nov16\).pdf](https://www.enel.com/content/dam/enel-com/investors/presentations/2016_10/Enel%20Group_2016%20Capital%20Markets%20Day%20(22Nov16).pdf)

- Tailored tariffs
- No access to the customers premises

6. Benefits for the distribution system operator

Smart metering is the first step to ensure sustainability, efficiency and a reliable supply of electricity, in addition:

- Better quality of service
- Support in networks management and planification
- Better losses detection
- Renewables integration
- Operations efficiency
- Real information, on an hourly basis
- Enabling new technology

Other benefits that smart metering brings in the activity of the distribution operator are:

- the reduction of the field activities: readings, activation / deactivation, the change of tariffs, the reduction of interventions of the type "lack access"

- the services offered to the customers: the accuracy of the measurement of the energy consumed, the invoicing of the real consumption, the efficiency of solving the complaints, the optimization of the back-office activity and implicitly the low costs of the services for the clients, better methodology of establishing the prices, thus generating flexible tariffs.

- logistic optimization: warehousing, transportation optimization, purchasing

- revenue management by identifying fraud attempts and network failures, eliminating payment delays and achieving an efficient energy balance.

All these benefits help in awareness of the behavior of all customers and the constant planning of activities within the distribution network.

In addition, the optimization of the aforementioned activities also leads to the optimization of the costs of the distribution operators, which translates into the reduction of the operational expenses per customer, a benefit that is transferred to the customer, adding to the improvement of the quality of the service, and an optimization of the distribution tariffs. For example, operating expenses per customer fell in Italy from 80 euros in 2001 to 48 euros in 2015, which represents an improvement of about 40%³.

³ [https://www.enel.com/content/dam/enel-com/investors/presentations/2016_10/Enel%20Group_2016%20Capital%20Markets%20Day%20\(22Nov16\).pdf](https://www.enel.com/content/dam/enel-com/investors/presentations/2016_10/Enel%20Group_2016%20Capital%20Markets%20Day%20(22Nov16).pdf)

7. Enel experience in smart metering

All these benefits were identified due to Enel's experience in the field of smart metering, an experience of over 25 years, which began in the 1990s with the solution design, followed between 1999 and 2001 by a redesign of the commercial process, so between 2001 and 2006 there were over 32 million meters for a complete roll-out in Italy. In 2010 began the installation of meters in Spain, which currently has 12 million such devices installed. The projects in Latin America and Romania followed, and from 2016 the installation of the second generation of smart meters in Italy began.

8. Cervantes Solution

The smart metering solution currently used in Romania is also called the Cervantes Solution, its characteristics being: energy balance, grid sensor, FW remotely upgradable, Plug and play, bidirectional, enhanced cyber security, PLC (Power Line Communication) embedded, remote reading and programming, remote relay management, programmable power limit, customer quality of services monitoring, prepayment, anti-tamper, flexible multi tariffs.

9. Conclusions

Smart meters are the basis of future smart grids. E-Distribution companies have already digitized most of the high and medium voltage networks, so that the equipment in these networks can be controlled remotely. The next natural step is to digitize low voltage networks using smart meters, which are not only a passive measuring equipment but an active component of the network. The purpose is to use the vast international experience of the Enel Group for the benefit of the clients in Romania. Smart grids, clean energy, sustainable mobility and energy efficiency reach customers homes with the help of smart meter innovations.

R E F E R E N C E S

- [1] *World Bank*, „World Development Indicators database”, September 2019
[2], [3] *Enel Group*, „Capital Markets Day Presentation”, London, November 2016

HIGH PERFORMANCE ASPECTS OF MHP EQUIPPED WITH EOS AND FO TURBINES

ASPECTE PRIVIND FUNCȚIONAREA CU RANDAMENT RIDICAT A MHC ECHIPATE CU TURBINE EOS ȘI FO

Cristian PURECE¹, Valeriu PANAITESCU², Irina ANGHEL-CHERA³

Abstract: *The micro-hydro aggregates for small hydro power plant (SHPP) and micro-hydro power plants (MHP) in low-energy hydro power have been designed to operate on the basis of the "everything or nothing" principle, taking into account their exploitation at optimum efficiency and simplification automation scheme. This principle proved to be inadequate due to the fact that small rivers are characterized by a daily, monthly or seasonal drainage with significant variation. Also, most of the micro-hydro power plants built in Romania after 1980 have the high installation coefficients (installed 2-3 times the power that could be obtained in continuous operation at the multi-annual average flow), which has the effect of producing energy discontinuous power distributed in hours of low operation for most of the year. Starting from the consideration that type FO (Horizontal Francis) and EOS type turbines (horizontal helical with the S-shaped hydraulic circuit) have very sensitive flow characteristics, the paper presents some technical ways of increasing the efficiency of the functioning of micro-hydro aggregates (MHA) equipped with standardized turbines.*

Keywords: efficiency, micr-hydro power plant, micro-hydro aggregate, multi-year average flow

Rezumat: *Microhidroagregatele ce echipează centralele hidroelectrice de mică putere (CHEMP) și microhidrocentrale (MHC) din cadrul amenajărilor hidroenergetice de mică putere au fost concepute să funcționeze pe baza principiului „tot sau nimic” (TSN), avându-se în vedere exploatarea lor la randamente optime și simplificarea schemei de automatizare. Acest principiu s-a dovedit a fi inadecvat datorită faptul că râurile mici se*

¹ Dr.ing. Cristian Purece, INCDE ICEMENERG, e-mail: cristianicemenerg@yahoo.com

² Emeritus Prof.dr. ing. Valeriu Panaitescu, University Politehnica Bucharest, e-mail: valeriu.panaitescu@yahoo.com

³ Asist. Irina Anghel-Chera, INCDE ICEMENERG, e-mail: irina.chera@icemenerg.ro

caracterizează printr-o scurgere zilnică, lunară sau sezonieră cu variație însemnată. De asemenea, majoritatea microhidrocentralelor construite în România după 1980 au coeficienți de instalare mari (putere instalată de 2-3 ori mai mare decât puterea care s-ar putea obține în funcționarea continuă la debitul mediu multianual), acest lucru având ca efect o producție energie electrică discontinuă repartizată în ore de funcționare puține în cea mai mare parte a anului. Pornind de la considerentul că turbinele tipizate de tip FO (Francis orizontal) și EOS (elicoidal orizontal cu circuitul hidraulic în formă de S) au caracteristici de randament foarte sensibile la variația debitului, în cadrul lucrării sunt prezentate câteva modalități tehnice de creștere a randamentului de funcționare al MHC-urilor echipate turbine tipizate.

Cuvinte cheie: randament, microhidrocentrală MHC, microhidroagregat MHA, debit mediu multianual

1. Introduction

Under the EU Directive on Renewable Energy Sources [1], it is set as a mandatory national target for all EU countries that, by 2020, renewable energy should account for 20% of the energy consumed. Within these sources, the production from hydro sources is estimated at about 18200 GWh / year, of which 1100 GWh in power plants with powers < 10 MW.

At the beginning of 2017, there were 118 economic operators that owned 317 low-capacity (less than 10 MW) electric power generation capacities - SHPPs and MHPs.

These low-energy hydro power together have an installed capacity of 341.6 MW, which represents about 5% of the total installed capacity on hydro. The production made in 2016 by these privately-owned SHPPs and MHPs was approx. 493 611 MWh, which represents about 3% of hydro power generation [2].

According to a study by Hidroelectrica [3] it is estimated that by 2025 the production of electricity from hydro sources will be at approx. 20 000 GWh / year (Figure 1).

The main features of these MHPs are diversity, specificity, design and execution concepts, exploitation mode.

These characteristics have resulted from the fact that they have been made at certain historical moments and in certain technical and economic circumstances.

Taking into account these desiderata, it is clear the necessity that, together with the new hydro-energetic facilities that will be built, the existing ones should be exploited in safety and efficiency, simultaneously with their rehabilitation or retrofitting.

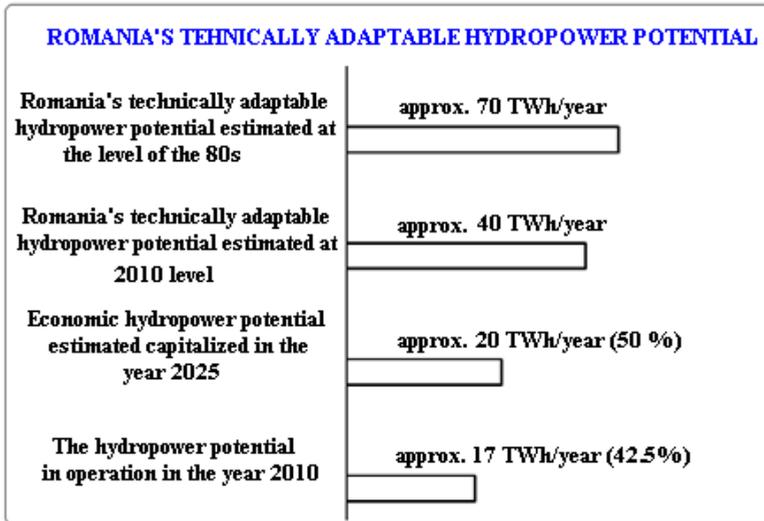


Figure 1. Scheme of Romania's technically feasible hydropower potential

The behavior and exploitation of equipment within MHPs requires the existence of indicators that characterize how well the intended purpose corresponds to its intended purpose through its design and execution.

In this respect, it would be necessary to separate the technical factor predominantly pursued in a specialized study, the human factor that should not be approached simplistically or insufficiently, as well as the conditions in which the equipment is exploited. Starting from the fact that these factors are difficult to separate due to the many relationships that exist between them, the analysis of the hydro-energetic equipment exploitation should be started by fixing and characterizing the conceptual structure of the MHPs equipped with EOS and FO turbines and their effective exploitation.

2. Conceptual Structure

At the basis of the design of these micro-hydro power plants (MHP with powers from 10 to 200 kW) and of small hydro power plants (SHPP with power from 200 to 3600 kW), the normative framework PE 306/90 [4] stipulates the main conditions technical, layout schemes and construction solutions. According to this normative, the following resulted:

- the variability of the river flows during one year required, in order to achieve a maximum energy output, the operation of the micro-hydro power

based on the principle of everything or nothing, with the application of an electromechanical action solution;

- installation coefficient, defined as the ratio between the installed flow and the average available energy flow rate (multiannual average decrease of the flow rate for the other uses) between 1 and 3;

- the equipment used in the construction of MHPs are generally typified, which, together with the technical and economical analysis of the design, has led to the choice of several variants regarding the river sector, the establishment of the installed flow, the diameter of the pipelines chosen in order to achieve the consistency with the arrangement;

- as these facilities do not have significant accumulations, the compensating basins being sized to a capacity that allows the operation of a turbine for 0.5 hours, the planned electricity production is not achieved;

- realization of the components of the arrangement according to simplified constructive solutions and type projects, having importance class IV (SHPP), respectively V (MHP);

- the use of standardized energy and hydromechanical equipment in domestic production (turbines, asynchronous generators, asynchronous motors in generator mode, etc.) [5]; this was possible by making an internal production of micro-aggregates consisting mainly of two series of Francis turbine types (FO - Figure 2) and helicoidal (EOS - Figure 3), coupled with asynchronous generators, equipment that has been approved; the micro-aggregate range was further supplemented with groups equipped with a Kaplan horizontal hydraulic circuit turbine (KOS) hydraulic turbine, which allows either double-stroke or rotor-controlled, asynchronous / synchronous generator.

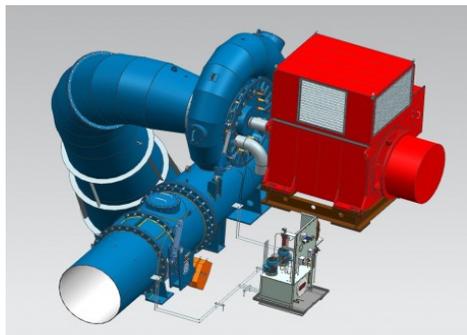


Figure 2. Francis horizontal turbine (FO)

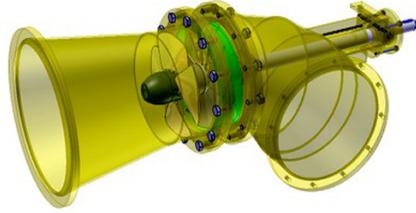


Figure 3. Horizontal turbine with S-shaped hydraulic circuit (EOS)

These framework normative criteria [4], with all their returns, have led to far-reaching outcomes, resulting in improvisational solutions, simplified design schemes, or design mistakes.

3. Characterization indicators for EOS And FO type turbines

For the characterization of low-energy hydro power installations equipped with EOS and FO turbines [6], a system of indicators is required that encompass all its component parts, but only a subjective arbitrary solution is possible. Taking into account the technical-economic design indicators (energy produced and the cost of energy), a series of indices can be detailed to show how much the arrangement is behaving. Thus, the energy produced in an average year is calculated with a relation:

$$E_n = K \times Q_m \times H \times 8760 \times \varepsilon_1 \times \varepsilon_2 \times 10^{-6} \text{ [GWh/year]} \quad (1)$$

where:

K is a coefficient that depends on the efficiency of micro-hydro aggregate and takes 7 for EOS and FO turbines;

Q_m - multiannual average flow;

H – net head (gross head from which the load losses are reduced);

8760 - the number of hours in a year;

ε_1 - stock utilization coefficient;

ε_2 - availability coefficient (0.8 for a unit and 0.9 for multiple units).

Analyzing the factors that intervene in the aforementioned relation can be ascertained:

a) The coefficient K assumes a 70% hydro-aggregate efficiency, considered as cover if it reaches its installed power. From the performance measurements by ICEMENERG [7], [8], it is noted that at the nominal

power for the EOS 500 turbine the efficiency was 66÷68%, and for EOS 1100 the efficiency was 74÷77%. At partial loads, efficiency falls rapidly, as can be seen from the graph in Figure 4.

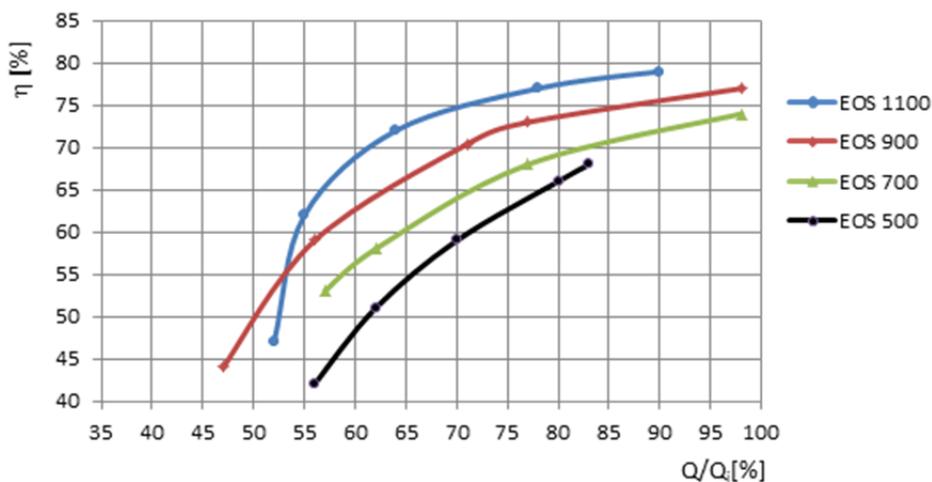


Figure 4. Efficiency variation by type EOS turbines flow

b) The average flow rate Q_m seen as a water flow constant based on multi-yearly measurements, gives indications of leakage volume over a long period of time. From the point of view of exploitation, it is essential to capitalize the daily flow of tributary, which is characterized by a pronounced variability, a measure of which is the coefficient of variation, having values between 0,3 - 0,74, for monthly average flows, its value rising far more for daily average flows.

c) Net head H , is the difference between the gross fall and the loss of the load. The loss of the calculated load in the design phase is underestimated, being mainly dependent on the pipe or adduction channel (large roughness due to poor executions) and the exploitation with a higher degree of clogging of the grids or the deposition of material alluvial on the hydraulic circuit.

d) Coefficient ε_1 , defined as the ratio between the stock of water and the annual stock, is difficult to estimate because the capacity of such arrangements is reduced. During the flood, a large amount of water is lost and, at the same time, during these periods the hydrotechnical boats have a faulty behavior. In order to determine this coefficient, it is necessary to have a system of measuring the volumes transited during the high water periods

and to make a hydraulic balance of an appropriate accuracy (less than 10%). During the small waters, the share of servitude, which in some cases reaches up to 50% of the tributary flow, takes an important share.

e) The stock availability coefficient ε_2 , determined by design according to the frame norm [4], has the values: 0,8 for a hydro aggregate and 0,9 for several hydro aggregates.

From the behavioral study for SHPPs and MHPs it ranges from 0.85 to 0.98, but in this indicator there is no indication of downtime including repair and maintenance times at various ovens and equipment.

In line with the existing design, construction, and operating deficiencies of MHPs, it is inevitable that much less electricity production than projected in the project will be. In most cases, energy in one year represents between 1÷80% of the project energy, and this interval does not allow for a pertinent conclusion, and can not be correlated with the hydraulicity of the year, the type of turbine or other factors.

4. Operation MHPs based on the "Everything or nothing" principle

4.1. "Everything or nothing" principle

In order to be exploited with optimum efficiency, micro-aggregates that equip low-energy hydropower were designed to operate on the principle of everything or nothing.

This type of operation involves the periodic operation of micro-aggregates by performing a number of start-stop cycles in one day, which has the following consequences:

- the occurrence of overpressures in the induction line at start and stop;
- packaging of micro-aggregates at the time of stopping;
- clogging of the compressor outlet and compartment;
- blocking intake butterfly valves in the turbine;
- the occurrence of frequent stresses of electromechanical installations (switch, actuator of the REGMO type instrument).

These stresses have a negative effect, such as breakage of the conduit through the sealing of the seals, the destruction of the bearings, etc.

In case of operation according to the all or nothing principle, the energy obtained is determined on the basis of the analysis of the operating cycle.

A working cycle has a duration t_c composed of a running time (t_f) and a fill time you (a pause period).

The fill type of the compensating basin depends on the tributary flow (Q_a), the loss through the directing device (Q_{ad}) and the volume of the compensating basin (V), which has the expression:

$$t_u = \frac{V}{Q_a - Q_{ad}} \quad (2)$$

Runtime is a sum of partial times

$$t_f = t'_0 + t''_0 + t_{exp} + t''_1 + t'_1 = A + t_{exp} \quad (3)$$

The allure of time of operation (3) is shown graphically in Figure 5.

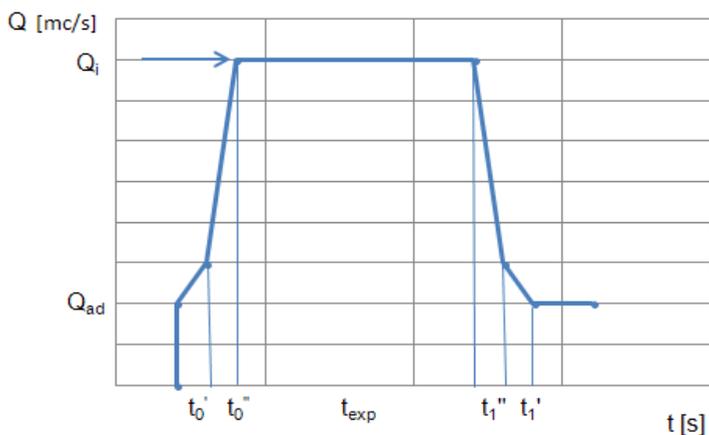


Figure 5. Operation chart based on everything or nothing

where:

- t'_0 - is the start time until the MHP connects to the network;
- t''_0 - the time needed for the MHP to reach the nominal regime;
- t_{exp} - the operating time to the nominal regime;
- t''_1 - the shutdown time up to the trigger limit from the system
- t'_1 - stop time of the MHP;
- A - a constant that depends on the turbine and the nominal regime imposed on it, namely the steering apparatus stroke and the shut-off speed of the REGMO,
- Q_i - installed MHP flow rate.

To determine the operating time of the MHP, the equation of the volume balance of the arrangement is written:

$$(t_0' + t_0'') \frac{Q_i + Q_{ad}}{2} + t_{exp} Q_i + (t_1' + t_1'') \frac{Q_i + Q_{ad}}{2} = V + Q_a t_f \quad (4)$$

If it is marked with:

V_0 the volume of water required to start the turbine

$$V_0 = (t_0' + t_0'') \frac{Q_i + Q_{ad}}{2} ,$$

V_1 the volume of water lost in stopping the turbine

$$V_1 = (t_1' + t_1'') \frac{Q_i + Q_{ad}}{2} ,$$

then the MHP time equation becomes:

$$t_f = \frac{Q_i A + V - V_0 - V_1}{Q_i - Q_a} \quad (5)$$

Taking into account that t_c is the duration of a start-stop cycle, the number of start-stop cycles (n) of a day is

$$n = \frac{24}{t_c} \quad (6)$$

The electrical energy produced in a start-stop cycle E_c is given by the relationship

$$E_c = 9,81 Q_i H(Q_i) \eta_{T+G} [Q_i, H(Q_i)] t_{exp} + 2E_c'' \quad (7)$$

where E_c'' is the energy produced during t_0'' and t_1'' is calculated with the relationship:

$$E_c'' = 9,81 \int_{t_0''}^{t_1''} Q(t) H(Q) \eta_{T+G}(Q, H) dt = \text{const.} \quad (8)$$

Electricity produced in a day working on the totality or nothing principle is calculated by the relationship:

$$E_{TSN} = n E_c \quad (9)$$

4.2. Advantages and disadvantages of operation according to the principle of "everything or nothing"

Operation based on the principle of "everything or nothing" has the advantage of obtaining a maximum yield by choosing such a nature of the turbine (Q_i installed flow rate, H calculation), but also by efficiently using

the water stock if the tributary flow is more smaller than the installed flow ($Q_a < Q_i$).

The disadvantage of this mode of operation of MHPs materializes through a large number of start-stop cycles; this number depends on the affluent Q_a flow and leads to: load of the electric circuit breaker bearings, shocks in the power transmission lines, blocking of the drive mechanisms of the steering apparatus and damage to the electric motors, erosion of the concrete basin and the escape channel, the fluctuating flow downstream of MHP, a fluctuation that makes it almost impossible to maintain an aquatic life.

5. Techniques to increase the performance of MHPs

By abandoning the exploitation based on the principle of "everything or nothing" and the adoption of continuous operation at the Q_a tributary flow, the coverage of the long-lasting average daily flow curve is no longer optimal, resulting in significant energy losses.

Given that the continued operation of MHPs is more appropriate when $Q_a \geq Q_i$, but usually $Q_a \leq Q_i$, which requires intermittent operation based on the principle "everything or nothing", consideration should be given to replacing existing MHAs with other MHAs with lower powers.

This also results from the fact that the vast majority of cases of energy-power hydropower with more MHAs offer a much more elastic seasonal flow adjustment scheme.

Based on the design on the same criteria according to the frame norm [4], the fragmentation of the flow is done in equal mode resulting in a number of identical MHAs.

However, the question of the opportunity of replacing an MHA with another available, with a lower nominal flow, requires a careful study, choosing the optimal variant is a decision-making problem that is solved on the basis of the multicriterial analysis due to the divergent tendencies in maximizing the energy obtained and minimizing spending.

One of the technical solutions that could be applied to the principle of "everything or nothing" in order to reduce the number of start-stops of an MHP equipped with a single MHA is to use a regulator to operate on the REGMO device to close the device director of the turbine according to the affluent Q_a flow, ensuring continuous operation of the MHA. It should be borne in mind that in the case of an MHP equipped with a single MHA it is

possible to operate at a minimum flow rate of 50% of the nominal flow, which means that the number of days of continuous operation in one year could also be about 100 for the low power hydro power plant located on rivers in the mountain range. The remaining 265 days The MHA must be intermittent. Thus, by reducing the value of the flow rate used from the maximum turbulent flow rate to 50% of the nominal flow, by closing the turbine guide vane, during periods when the flow rate of the tributary flow is lower, an increase in the duration of operation of the MHA acquires.

Another way to increase the efficiency of running MHAs can be to change the installation angle of the rhetoric blades. This solution involves removing the rotor blades and placing them at a lower angle than the one corresponding to the nominal flow.

The optimal angle setting is based on turbine characteristics and is generally lower by 5° , which corresponds to a 30% reduction in flow rate and an 8.5% increase in efficiency compared to the original one.

In this case, the main drawback is that run blades are welded, seasonal adjustment is difficult to achieve, requiring specific devices and skilled personnel.

Another option may be to purchase a spare run with the installation angle at the desired value.

This variant is warranted if each run has a service life of approx. 3000 hours per year.

The above solution is viable if you can easily adjust the installation angle. For a seasonal adjustment, a mechanical device can be adapted to change and lock the installation angle to a certain value. The use of KOS type turbines is too demanding to be used in this case.

6. Conclusions

By efficiently capitalizing the Romanian hydropower potential, the use of fossil fuels for energy purposes is reduced, for which important funds are spent annually; reducing energy loss on transport lines; an important number of localities are supplied with energy; eliminates voltage drops in distant areas of electrical networks; reduce the number of floods of localities and lands; a large number of jobs are created.

According to the analyzes presented in the article, we note the following ways of adapting EOS type turbines for their optimal efficiency in the case of the reduction of the turbulent flow at the value of the tributary flow:

- changing the angle of rotor blade installation, which requires studies to achieve a technical solution for seasonal adjustment;
- reducing the number of start-up cycles of an MHA by using a regulator that acts on the REGMO device to close the turbine directing device according to the tributary flow;
- replacing the existing MHA with a smaller MHA with a lower power corresponding to the tributary flow. The features of the new MHP are derived from a pertinent technical and economic analysis.

These solutions can be applied during retrofitting, following a feasibility study.

For a real optimization of the operation of small hydropower developments, an in-situ [9] verification of exploitation characteristics and technical / economic indices resulting from the project is required. In addition to the performance of MHAs (as compared to the service topographies guaranteed by the equipment provider) in the performance tests [10], the actual MHA consumption (power-to-flow) characteristic is also being developed.

This allows for the efficient use of water available in a hydropower facility and the premises for a pertinent analysis of how MHA works.

In order to make a visible progress in the micro-hydro power field, the efforts made so far (setting up a MHP realization concept, training the personnel needed for MHP exploitation, creating an internal MHP production) should be continued; this is in line with the current micro-hydro policy in other countries where rivers with energy parameters similar to those of the Romanian water courses frequently build hydro power plants of low energy.

REFERENCES

- [1] *** European Directive 2009/28 / EC of the European Parliament and of the Council of 23 April 2009: Promoting the use of renewable energy
- [2] *** Competition Council Research Directorate, „The sector inquiry on the management of surface water resources and effects on downstream markets (electricity and irrigation),” Report 11.13.2017
- [3] *** Hidroelectrica, “Strategy for the privatization of micro-hydro power plants in the context of regional development,” Seminar micro-hydro Romania potential, Bucharest February 20, 2014
- [4] *** PE 306, „Framework normative for the design of small hydropower plants and power plants,” Bucuresti 1990
- [5] I. Hoța, I. Bejan, Gh. Zincescu, W. Dorn, G. Mortoiu, „Compact micro-aggregates in the range of 10-100 kW, developed at UC.M. Reșița, Fourth Conference of Hydro-

- energetic in Romania, in memory of the teacher Dorin Pavel,” 26–27 May 2006, Ed. Printech, Bucharest, pages 789–806
- [6] M. O. POPOVICIU, I. BORDEAȘU, „The need to capitalize the hydraulic micro-potentials in Romania,” AGIR bulletin no. 3 July-September 2007, pages 62-68
- [7] ***Study, „Verification of performance of EOS hydro-aggregate from MHP Dej Monastery,” elaborated by ICEMENERG, Bucharest 1985
- [8] *** Study, „Determination of real operational parameters at MHP Hemeiuși and Casin I,” ICEMENERG, Bucharest 1989
- [9] ***CEI 41 1991-11, „Field acceptance tests to determine the hydraulic performance of hydraulic turbines, storage pumps and pumps-turbines,” Geneva, Switzerland, 3th. edition 1991
- [10] ***CEI 62006, „Hydraulic machines. Acceptance tests of small hydroelectric installations,” Geneva, Switzerland, 1st. edition 2010